




	<b>Receiver</b>	<b>From</b>
Company name		
Respons. Department		
Person in charge		
Phone number		
Fax no		
E-mail address		

Operating area	Flow	Head	Impeller type	Peripheral impeller
Operating data specification	0 m <sup>3</sup> /h	0 m	Impeller construction	
Pump data	m <sup>3</sup> /h	m	Sense of rotation	Clockwise from the drive end
			Outlet width	G1"
	Flow: Min. Max. $\eta_{Max.}$ m <sup>3</sup> /h m <sup>3</sup> /h m <sup>3</sup> /h		Shaft power P2: P2(Q=0) Max. $\eta_{Max.}$ kW kW kW	
	Head: H(Q=0) $\eta_{Max.}$ m m		Speed	1/min 2850
	0.581 2.4 1.82		Frequency	Hz 50 Hz
	38.8 16.8			
	0.259 0.191			

 Performance data based to: Water, pure [100%]; 20°C; 0.998kg/dm<sup>3</sup>; 1mm<sup>2</sup>/s

UNI EN ISO 9906:2012 - Grade 3B

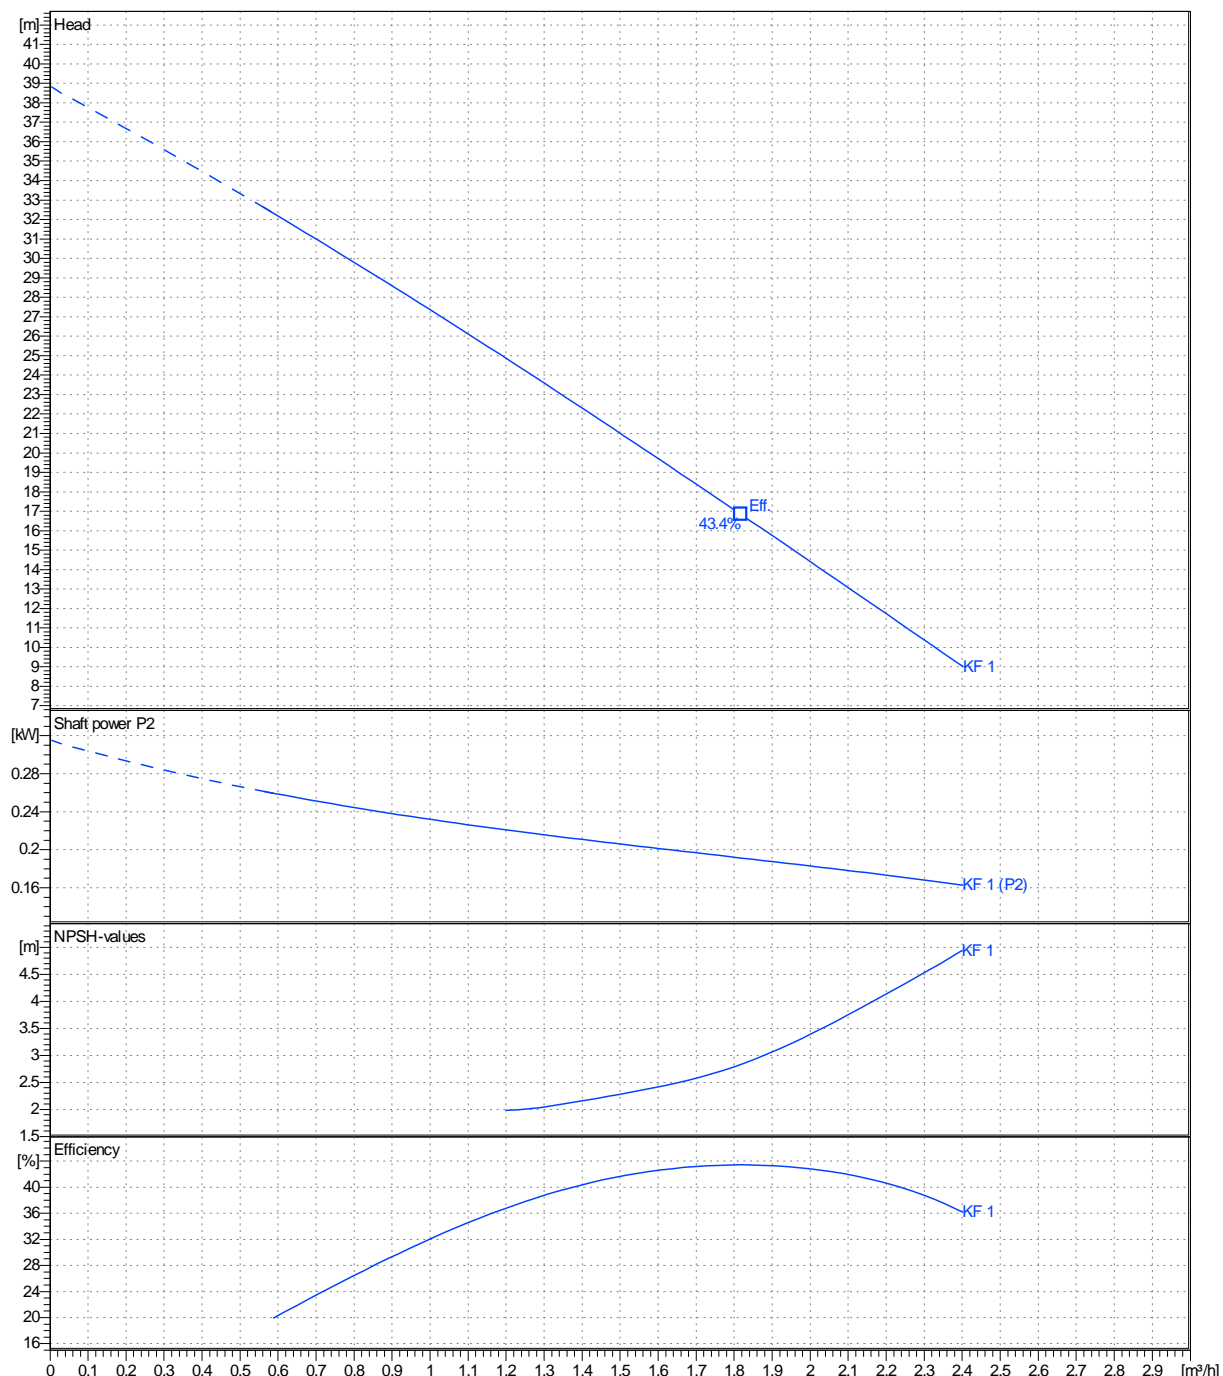

Project	Project ID	Created by	Created on <b>2020-09-24</b>	Last update
---------	------------	------------	---------------------------------	-------------